


DRINKING WATER

Carbon Tetrachloride concentrations in the RWMC Well and Distribution System (1994 through 2nd quarter 2004)

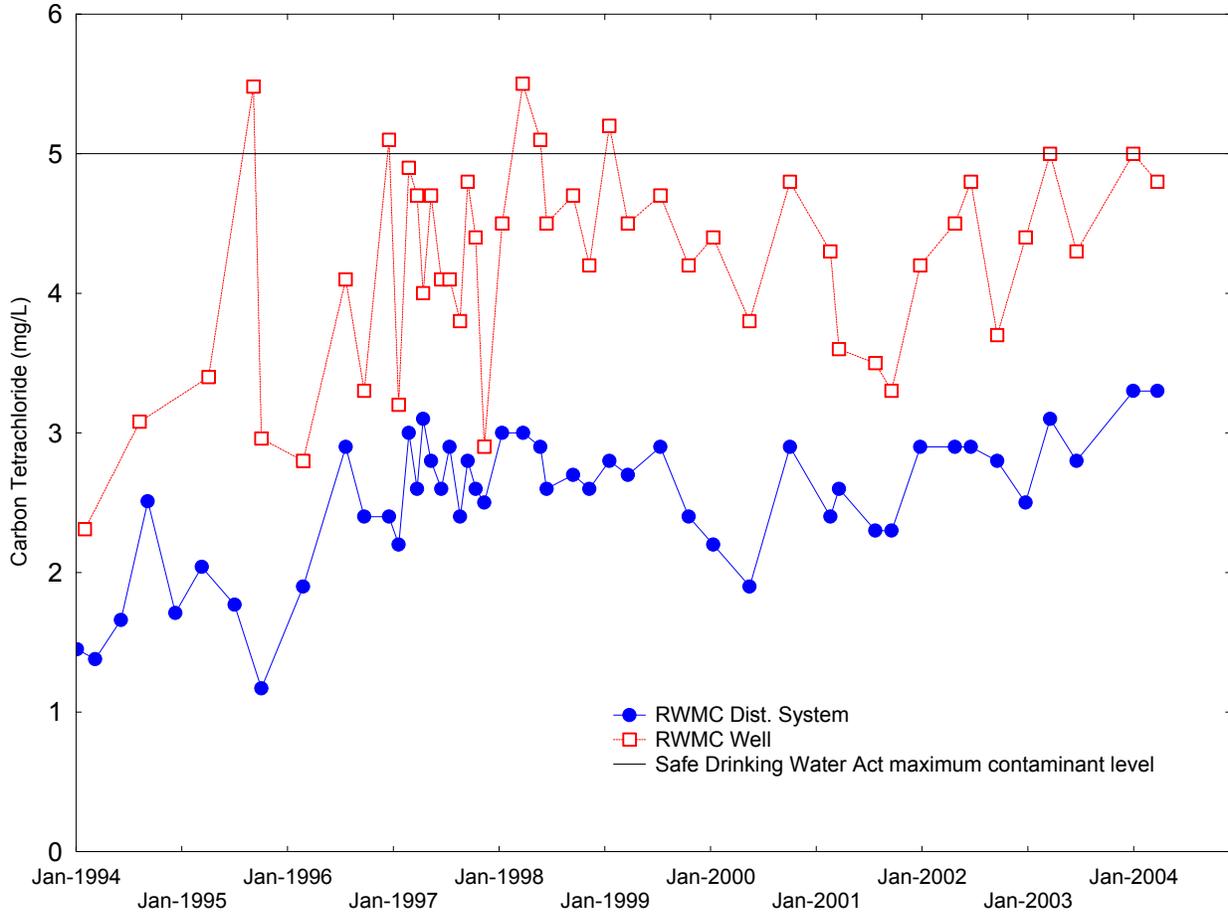

The point of compliance is the RWMC Distribution System, which has historically been below the maximum contaminant level.

FOR MORE INFORMATION
 Contact: Roger Wilhelmsen
 208-526-9401
rnw@inel.gov